# PROPOSED BUILDING FOR: GOLDEN OIL COMPANY, LLC

# PLEASANT SPRINGS,


## LEGEND

000.00	PROPOSED SPOT ELEVATIONS (FLOW LINE OF CURB UNLESS	*	EXISTING CONIFEROUS TREE
	OTHERWISE SPECIFIED)		EXISTING SHRUB
000.00		月 JRFACE GRADE	EXISTING STUMP
	AT BOTTOM OF WALL)		SOIL BORING
000.00		(1)	EXISTING WELL
000.00		₩	PROPOSED WELL
<b>●</b> [000.00]	BW (TOP OF WALK, BOTTOM OF WALK)  EXISTING WATER VALVE IN BOX	ф	EXISTING LIGHT POLE
8	PROPOSED WATER VALVE IN BOX	<del></del>	EXISTING SIGN
<b>⊗</b>	EXISTING WATER VALVE IN MANHOLE	Ę	CENTER LINE
*	EXISTING WATER SERVICE VALVE	<u>L</u>	EXISTING HANDICAP PARKING STALL
T	EXISTING TELEPHONE MANHOLE	وگر	PROPOSED HANDICAP PARKING STALL
	EXISTING ROUND CATCH BASIN	$\bowtie$	EXISTING GAS VALVE
<b></b>	PROPOSED ROUND CATCH BASIN		
<b>=</b>	EXISTING SQUARE CATCH BASIN	٧,	EXISTING WOODED AREA
Ė	EXISTING CURB INLET		EXISTING HEDGE
	PROPOSED CURB INLET	<del></del>	EXISTING CHAINLINK FENCE
			EXISTING WOOD FENCE
Ø	EXISTING UTILITY POLE	×	EXISTING BARBED WIRE FENCE
$\varnothing \longrightarrow$	EXISTING UTILITY POLE WITH GUY WIRE		PROPERTY LINE
<b>○</b>	EXISTING STREET LIGHT	0 0 0 0	EXISTING GUARD RAIL
T	EXISTING TELEPHONE PEDESTAL	ST	EXISTING STORM SEWER AND MANHOLE
E	EXISTING ELECTRIC PEDESTAL	—— st ————	PROPOSED STORM SEWER AND MANHOLE
	EXISTING ELECTRIC BOX	SA	EXISTING SANITARY SEWER AND MANHOLE
©	EXISTING CABLE TV PEDESTAL	—— SA —————————————————————————————————	PROPOSED SANITARY SEWER AND MANHOLE
	PROPOSES PRANCASES SURV	w	EXISTING WATER LINE AND HYDRANT
$\longrightarrow$	PROPOSED DRAINAGE FLOW	w	PROPOSED WATER LINE AND HYDRANT
	1-1/4" REBAR SET WEIGHING 4.30 LB/FT.	OU	EXISTING OVERHEAD UTILITY LINE
•	3/4" REBAR SET	——— FO ———	EXISTING UNDERGROUND FIBER OPTIC LINE
	WEIGHING 1.50 LB/FT. 1-1/4" REBAR FOUND	— E —	EXISTING UNDERGROUND ELECTRIC CABLE  EXISTING UNDERGROUND TELEPHONE CABLE
0	3/4" REBAR FOUND	G	EXISTING UNDERGROUND GAS LINE
<b>∅</b>	2" IRON PIPE FOUND		PROPOSED CURB AND GUTTER
<b>A</b>	1" IRON PIPE FOUND		EXISTING CURB AND GUTTER
€	EXISTING FLOOD LIGHT		GRADING/SEEDING LIMITS
<b></b>	SECTION CORNER		RIGHT-OF-WAY LINE
<del>\</del>	PROPOSED APRON ENDWALL		PROPERTY LINE
<u> 4112</u>	EXISTING MARSH AREA		RAILROAD TRACKS
	EXISTING MARSH AREA  EXISTING DECIDUOUS TREE	800	EXISTING GROUND CONTOUR
	WITH TRUNK DIAMETER	800	PROPOSED GROUND CONTOUR

# DRAZKOWSKI 40127-006

SHEET	SHEET TITLE
C1.0	CIVIL COVER AND SPECIFICATION SHEET
C1.1	EXISTING SITE AND DEMOLITION PLAN
C1.2	SITE PLAN
C1.3	GRADING AND EROSION CONTROL PLAN
C1.4	UTILITY PLAN
C1.5	LANDSCAPE PLAN
C1.6	DETAILS



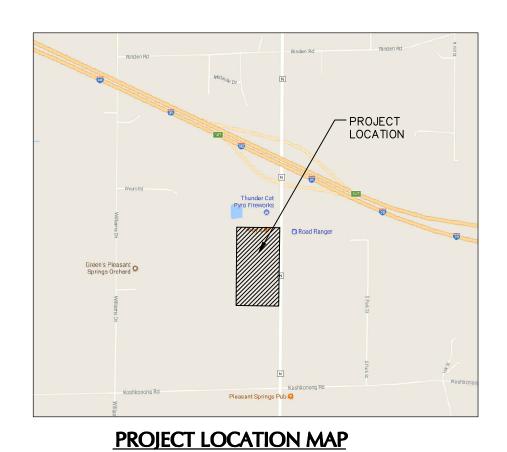

# PLAN SPECIFICATIONS

#### **DIVISION 31 EARTH WORK**

#### 31 10 00 SITE CLEARING (DEMOLITION)

A. CONTRACTOR SHALL CALL DIGGER'S HOT LINE AND CONDUCT A PRIVATE UTILITY LOCATE AS REQUIRED TO ENSURE THAT ALL UTILITIES HAVE BEEN LOCATED BEFORE STARTING SITE DEMOLITION. DESIGN ENGINEER SHALL BE NOTIFIED OF ANY DISCREPANCIES BETWEEN PLAN AND FIELD CONDITIONS PRIOR TO B. DEMOLITION PLAN IS AN OVERVIEW OF DEMOLITION TO TAKE PLACE ON SITE. CONTRACTOR TO FIELD VERIFY EXISTING SITE CONDITIONS PRIOR TO BIDDING. CONTRACTOR SHALL REMOVE, REPLACE, OR DEMOLISH ALL ITEMS AS NEEDED DURING CONSTRUCTION. C. CONTRACTOR TO PROTECT EXISTING IMPROVEMENTS THAT ARE SCHEDULED TO REMAIN. ANY DAMAGE TO EXISTING FACILITIES SHALL BE REPLACED AT D. ALL CONCRETE NOTED TO BE REMOVED SHALL BE REMOVED TO THE NEAREST CONTROL JOINT.

#### 31 20 00 EARTH MOVING

A. CONTRACTOR SHALL CALL DIGGER'S HOT LINE AND CONDUCT A PRIVATE UTILITY LOCATE AS REQUIRED TO ENSURE THAT ALL UTILITIES HAVE BEEN LOCATED BEFORE STARTING EXCAVATION. DESIGN ENGINEER SHALL BE NOTIFIED OF ANY DISCREPANCIES BETWEEN PLAN AND FIELD CONDITIONS PRIOR TO

B. PROVIDE ALL LABOR. MATERIALS AND EQUIPMENT FOR ALL EXCAVATION, GRADING, FILL AND BACKFILL WORK AS REQUIRED TO COMPLETE THE GENERAL CONSTRUCTION WORK. ALL EXCAVATION AND BACKFILL FOR ELECTRICALS AND MECHANICALS ARE THE RESPONSIBILITY OF THE RESPECTIVE CONTRACTOR C. ALL ORGANIC TOPSOIL INSIDE THE BUILDING AREA, UNDER PAVED AREAS, AND AT SITE FILL AREAS SHALL BE REMOVED. PROOF ROLL SUBGRADES BEFORE PLACING FILL WITH HEAVY PNEUMATIC-TIRED EQUIPMENT, SUCH AS A FULLY-LOADED TANDEM AXLE DUMP TRUCK, TO IDENTIFY SOFT POCKETS AND AREAS OF EXCESS YIELDING. CONTRACTOR SHALL VERIFY TOPSOIL DEPTHS PRIOR TO CONSTRUCTION. THE CONTRACTOR SHALL REVIEW AND FOLLOW THE RECOMMENDATIONS OF THE GEOTECHNICAL REPORT AND ACCOUNT FOR EXISTING CONDITIONS PRIOR TO SUBMITTING BID FOR THE PROJECT. EXCESS MATERIALS SHALL BE REMOVED FROM THE SITE UNLESS OTHERWISE DIRECTED IN THE PLANS OR BY LOCAL ZONING REQUIREMENTS. D. PLACE AND COMPACT FILL MATERIAL IN LAYERS TO REQUIRED ELEVATIONS. UNIFORMLY MOISTEN OR AERATE SUBGRADE AND EACH SUBSEQUENT FILL OR BACKFILL LAYER BEFORE COMPACTION AS RECOMMENDED TO ACHIEVE SPECIFIED DRY DENSITY. REMOVE AND REPLACE, OR SCARIFY AND AIR DRY,

OTHERWISE SATISFACTORY SOIL MATERIAL THAT IS TOO WET TO COMPACT TO SPECIFIED DRY DENSITY. E. PLACE BACKFILL AND FILL MATERIALS IN LAYERS NOT MORE THAN 8" IN LOOSE DEPTH FOR MATERIAL COMPACTED BY HEAVY COMPACTION EQUIPMENT. ANI NOT MORE THAN 4" IN LOOSE DEPTH FOR MATERIAL COMPACTED BY HAND-OPERATED TAMPERS. F. COMPACT THE SOIL TO NOT LESS THAN THE FOLLOWING PERCENTAGES OF MAXIMUM DRY DENSITY ACCORDING TO ASTM D 698. STANDARD PROCTOR TEST, FILL MAY NOT BE PLACED ON FROZEN GROUND AND NO FROZEN MATERIALS MAY BE USED FOR BACK FILL. APPLY THE MORE STRINGENT REQUIREMENTS WHEN COMPARING BETWEEN THE FOLLOWING AND THE GEOTECHNICAL REPORT.

1. UNDER FOUNDATIONS - SUBGRADE, AND EACH LAYER OF BACKFILL OR FILL MATERIAL, TO NOT LESS THAN 98 PERCENT. 2. UNDER INTERIOR SLAB-ON-GRADE WHERE GROUNDWATER IS MORE THAN 3 FEET BELOW THE SLAB - PLACE A DRAINAGE COURSE LAYER OF 3/4" CRUSHED STONE, WITH 5% TO 12% FINES, PER THICKNESS INDICATED ON FOUNDATION PLANS ON PREPARED SUBGRADE. COMPACT THE SUBGRADE AND DRAINAGE 3. UNDER INTERIOR SLAB-ON-GRADE WHERE GROUNDWATER IS WITHIN 3 FEET OF THE SLAB SURFACE- PLACE A DRAINAGE COURSE LAYER OF CLEAN 3/4" CRUSHED STONE, WITH NO MORE THAN 5% FINES, PER THICKNESS INDICATED ON FOUNDATION PLANS ON PREPARED SUBGRADE. COMPACT THE SUBGRADE AND DRAINAGE COURSE TO NOT LESS THAN 95 PERCENT.

4. UNDER EXTERIOR CONCRETE AND ASPHALT PAVEMENTS - COMPACT THE SUBGRADE AND EACH LAYER OF BACKFILL OR FILL MATERIAL TO NOT LESS THAN 95

5. UNDER WALKWAYS - COMPACT SUBGRADE AND EACH LAYER OF BACKFILL OR FILL MATERIAL TO NOT LESS THAN 95 PERCENT 6. UNDER LAWN OR UNPAVED AREAS - COMPACT SUBGRADE AND EACH LAYER OF BACKFILL OR FILL MATERIAL, TO NOT LESS THAN 85 PERCENT. G. CONTRACTOR SHALL ENGAGE A QUALIFIED INDEPENDENT TESTING AND INSPECTING AGENCY TO PERFORM FIELD TESTS AND INSPECTIONS. IT IS SUGGESTED THAT THE GEOTECHNICAL FIRM USED TO PERFORM THE SUBSURFACE SOIL INVESTIGATION BE ENGAGED FOR THE FIELD QUALITY CONTROL TESTS. H. ALLOW THE TESTING AGENCY TO TEST AND INSPECT SUBGRADES AND EACH FILL OR BACKFILL LAYER. PROCEED WITH SUBSEQUENT EARTHWORK ONLY AFTER TEST RESULTS FOR PREVIOUSLY COMPLETED WORK COMPLY WITH REQUIREMENTS. PROVIDE ONE TEST FOR EVERY 2000 SQUARE FEET OF PAVED AREA OR BUILDING SLAB, ONE TEST FOR EACH SPREAD FOOTING, AND ONE TEST FOR EVERY 50 LINEAR FEET OF WALL STRIP FOOTING. WHEN THE TESTING AGENCY REPORTS THAT SUBGRADES. FILLS. OR BACKFILLS HAVE NOT ACHIEVED DEGREE OF COMPACTION. SPECIFIED, SCARIFY AND MOISTEN OR AERATE. OR REMOVE AND REPLACE SOIL TO DEPTH REQUIRED: RECOMPACT AND RETEST UNTIL SPECIFIED COMPACTION IS OBTAINED. J. THE BUILDING SITE SHALL BE GRADED TO PROVIDE DRAINAGE AWAY FROM THE BUILDING AS INDICATED ON THE PLANS. SITE EARTHWORK SHALL BE GRADED TO

#### 31 30 00 EROSION CONTROL/STORMWATER MANAGEMENT

A. THE DESIGN ENGINEER SHALL PREPARE A SITE SPECIFIC EROSION CONTROL AND A STORMWATER MANAGEMENT PLAN PURSUANT TO NR 216.46 AND NR 216.47. THE DESIGN ENGINEER SHALL ALSO FILE A CONSTRUCTION NOTICE OF INTENT WITH THE WISCONSIN DEPARTMENT OF NATURAL RESOURCES PURSUANT TO NR 216.43 OR TO AN AUTHORIZED LOCAL PROGRAM PURSUANT TO NR 216.415 TO OBTAIN COVERAGE UNDER THE GENERAL WPDES STORM WATER PERMIT. B. THE CONTRACTOR SHALL KEEP THE NOTICE OF INTENT PERMIT, APPROVED EROSION CONTROL AND STORMWATER MANAGEMENT PLANS, AND PLAN AMENDMENTS ON THE CONSTRUCTION SITE AT ALL TIMES UNTIL PERMIT COVERAGE IS TERMINATED. C. THE CONTRACTOR IS RESPONSIBLE FOR OBTAINING ALL LOCAL EROSION CONTROL PERMITS.

WITHIN 0.10' OF REQUIRED EARTHWORK ELEVATIONS ASSUMING POSITIVE DRAINAGE IS MAINTAINED IN ACCORDANCE WITH THE GRADING PLAN.

D. THE CONTRACTOR SHALL BE RESPONSIBLE FOR MEETING THE MONITORING. MAINTENANCE, AND REPORTING REQUIREMENTS OF NR 216.48. INSPECTIONS OF IMPLEMENTED EROSION AND SEDIMENT CONTROL BEST MANAGEMENT PRACTICES MUST AT A MINIMUM BE INSPECTED EVERY 7 DAYS AND WITHIN 24 HOURS AFTER A PRECIPITATION EVENT OF 0.5" OR MORE. A PRECIPITATION EVENT MAY BE CONSIDERED TO BE THE TOTAL AMOUNT OF PRECIPITATION RECORDED IN ANY CONTINUOUS 24-HOUR PERIOD. THE CONTRACTOR SHALL REPAIR OR REPLACE EROSION AND SEDIMENT CONTROL AS NECESSARY WITHIN 24 HOURS OF AN INSPECTION OR AFTER A DEPARTMENT NOTIFICATION WHERE REPAIR OR REPLACEMENT IS REQUESTED. E. THE CONTRACTOR SHALL MAINTAIN, AT THE CONSTRUCTION SITE, WEEKLY WRITTEN REPORTS OF ALL INSPECTIONS CONDUCTED. WISCONSIN DNR CONSTRUCTION SITE INSPECTION REPORT FORM 3400-187 SHALL BE USED. WEEKLY INSPECTION REPORTS SHALL INCLUDE ALL OF THE FOLLOWING:

2. THE NAME OF THE INDIVIDUAL WHO PERFORMED THE INSPECTION. 3. AN ASSESSMENT OF THE CONDITION OF THE EROSION AND SEDIMENT CONTROLS.

4. A DESCRIPTION OF ANY EROSION AND SEDIMENT CONTROL IMPLEMENTATION AND MAINTENANCE PERFORMED 5. A DESCRIPTION OF THE PRESENT PHASE OF LAND DISTURBING CONSTRUCTION ACTIVITY AT THE CONSTRUCTION SITE F. EROSION AND SEDIMENT CONTROL IMPLEMENTED DURING CONSTRUCTION SHALL STRICTLY COMPLY WITH THE GUIDELINES AND REQUIREMENTS SET FORTH IN

WISCONSIN ADMINISTRATIVE CODE (W.A.C.) NR 151. THE STATE OF WISCONSIN DEPARTMENT OF NATURAL RESOURCES RUNOFF MANAGEMENT PERFORMANCE STANDARDS. TECHNICAL STANDARDS PUBLISHED BY THE WISCONSIN DNR SHALL ALSO BE UTILIZED TO IMPLEMENT THE REQUIRED PERFORMANCE STANDARDS. THE METHODS AND TYPES OF EROSION CONTROL WILL BE DEPENDENT ON THE LOCATION AND TYPE OF WORK INVOLVED. ALL SEDIMENT CONTROL MEASURES SHALL BE ADJUSTED TO MEET FIELD CONDITIONS AT THE TIME OF CONSTRUCTION, AND INSTALLED PRIOR TO ANY GRADING OR DISTURBANCE OF EXISTING SURFACE MATERIAL. BELOW IS A LIST OF EROSION AND SEDIMENT CONTROL BEST MANAGEMENT PRACTICES TO ACHIEVE THE PERFORMANCE STANDARDS 1. SILT FENCE SHALL BE PLACED ON SITE AT LOCATIONS SHOWN ON THE EROSION CONTROL PLAN. SILT FENCE SHALL ALSO BE PROVIDED AROUND THE

PERIMETER OF ALL SOIL STOCKPILES. FOLLOW PROCEDURES FOUND IN WISCONSIN DNR TECHNICAL STANDARD 1056. 2. DITCH CHECKS SHALL BE PROVIDED TO REDUCE THE VELOCITY OF WATER FLOWING IN DITCH BOTTOMS. PLACE AT LOCATIONS SHOWN ON THE EROSION CONTROL PLAN FOLLOW PROCEDURES FOUND IN WISCONSIN DNR TECHNICAL STANDARD 1062 3. STONE TRACKING PADS SHALL BE PLACED AT ALL CONSTRUCTION SITE ENTRANCES AND SHALL BE INSTALLED PRIOR TO ANY TRAFFIC LEAVING THE CONSTRUCTION SITE. SEE THE EROSION CONTROL PLAN FOR LOCATIONS. THE AGGREGATE USED SHALL BE 3 TO 6 INCH CLEAR OR WASHED STONE, AND SHALL BE PLACED IN A LAYER AT LEAST 12 INCHES THICK. THE STONE SHALL BE UNDERLAIN WITH A WISDOT TYPE R GEOTEXTILE FABRIC. THE TRACKING PAD SHALL BE THE FULL WIDTH OF THE EGRESS POINT, AND SHALL BE A MINIMUM OF 50 FEET LONG. SURFACE WATER MUST BE PREVENTED FROM PASSING THROUGH THE TRACKING PAD. FOLLOW PROCEDURES FOUND IN WISCONSIN DNR TECHNICAL STANDARD 1057. 4. STORM DRAIN INLET PROTECTION SHALL BE PROVIDED FOR ALL NEW AND DOWNSTREAM STORM CATCH BASINS AND CURB INLETS. TYPE B OR C PROTECTION SHOULD BE PROVIDED AND SHALL BE IN CONFORMANCE WITH WISCONSIN DNR TECHNICAL STANDARD 1060

5. DUST CONTROL MEASURES SHALL BE PROVIDED TO REDUCE OR PREVENT THE SURFACE AND AIR TRANSPORT OF DUST DURING CONSTRUCTION. CONTROL MEASURES INCLUDE APPLYING MULCH AND ESTABLISHING VEGETATION, WATER SPRAYING, SURFACE ROUGHENING, APPLYING POLYMERS, SPRAY-ON TACKIFIERS, CHLORIDES, AND BARRIERS. SOME SITES MAY REQUIRE AN APPROACH THAT UTILIZES A COMBINATION OF MEASURES FOR DUST CONTROL. FOLLOW PROCEDURES FOUND IN WISCONSIN DNR TECHNICAL STANDARD 1068. 6. THE USE, STORAGE, AND DISPOSAL OF CHEMICALS, CEMENT, AND OTHER COMPOUNDS AND MATERIALS USED ON SITE SHALL BE MANAGED DURING THE CONSTRUCTION PERIOD TO PREVENT THEIR TRANSPORT BY RUNOFF INTO WATERS OF THE STATE. 7. CONTRACTOR SHALL PROVIDE AN OPEN AGGREGATE CONCRETE TRUCK WASHOUT AREA ON SITE. CONTRACTOR TO ENSURE THAT CONCRETE WASHOUT

SHALL BE CONTAINED TO THIS DESIGNATED AREA AND NOT BE ALLOWED TO RUN INTO STORM INLETS OR INTO THE OVERLAND STORMWATER DRAINAGE SYSTEM. WASHOUT AREA SHALL BE REMOVED UPON COMPLETION OF CONSTRUCTION. 8. TEMPORARY SITE RESTORATION SHALL TAKE PLACE IN DISTURBED AREAS THAT WILL NOT BE BROUGHT TO FINAL GRADE OR ON WHICH LAND DISTURBING ACTIVITIES WILL NOT BE PERFORMED FOR A PERIOD GREATER THAN 14 DAYS AND REQUIRES VEGETATIVE COVER FOR LESS THAN ONE YEAR. THIS TEMPORARY SITE RESTORATION REQUIREMENT ALSO APPLIES TO SOIL STOCKPILES. PERMANENT RESTORATION APPLIES TO AREAS WHERE PERENNIAL VEGETATIVE COVER IS NEEDED TO PERMANENTLY STABILIZE AREAS OF EXPOSED SOIL. PERMANENT STABILIZATION SHALL OCCUR WITHIN 3 WORKING DAYS OF FINAL GRADING. TOPSOIL, SEED, AND MULCH SHALL BE IN GENERAL CONFORMANCE WITH TECHNICAL STANDARDS 1058 AND 1059 AND SHALL MEET THE SPECIFICATIONS FOUND IN THE LANDSCAPING AND SITE STABILIZATION SECTION OF THIS CONSTRUCTION DOCUMENT. ANY SOIL EROSION THAT OCCURS AFTER FINAL GRADING AND/OR FINAL STABILIZATION MUST BE REPAIRED AND THE STABILIZATION WORK REDONE. 9. IF SITE DEWATERING IS REQUIRED TO REMOVE SEDIMENT FROM CONSTRUCTION SITE STORMWATER PRIOR TO DISCHARGING OFF-SITE OR TO WATERS OF THE STATE, FOLLOW PROCEDURES FOUND IN TECHNICAL STANDARD 1061. 10. ALL OFF-SITE SEDIMENT DEPOSITS OCCURRING AS A RESULT OF CONSTRUCTION WORK OR A STORM EVENT SHALL BE CLEANED UP BY THE END OF EACH

WORKING DAY. FLUSHING SHALL NOT BE ALLOWED. G. EROSION CONTROL MEASURES SHALL NOT BE REMOVED UNTIL THE AREA(S) SERVED HAVE ESTABLISHED VEGETATIVE COVER. H. ONCE THE CONSTRUCTION SITE HAS BEEN FULLY STABILIZED AND TEMPORARY EROSION CONTROL BEST MANAGEMENT PRACTICES HAVE BEEN REMOVED, THE CONTRACTOR SHALL FILE A CONSTRUCTION NOTICE OF TERMINATION WITH THE WISCONSIN DEPARTMENT OF NATURAL RESOURCES. . AT THE COMPLETION OF THE PROJECT, THE CONTRACTOR SHALL GIVE THE OWNER COPIES OF THE EROSION CONTROL AND STORM WATER MANAGEMENT PLANS, AMENDMENTS TO PLANS, SUPPORTING PLAN DATA, AND CONSTRUCTION SITE EROSION CONTROL INSPECTION REPORTS. THE OWNER SHALL RETAIN THESE FOR A PERIOD OF 3 YEARS FROM THE DATE OF TERMINATING COVERAGE UNDER WPDES GENERAL PERMIT. J. ALL POST CONSTRUCTION STORMWATER MANAGEMENT BEST MANAGEMENT PRACTICES SHALL BE CONSTRUCTED BEFORE THE SITE HAS UNDERGONE FINAL

## **DIVISION 32 EXTERIOR IMPROVEMENTS**

## 32 10 00 AGGREGATE BASE & ASPHALT PAVEMENT

A. CONTRACTOR TO PROVIDE COMPACTED AGGREGATE BASE AND HOT MIX ASPHALT PAVEMENT WHERE INDICATED ON THE PLANS. ALL AGGREGATE PROVIDED MUST COMPLY WITH SECTION 305 OF THE WISCONSIN STANDARD SPECIFICATIONS FOR HIGHWAY AND STRUCTURE CONSTRUCTION. PROVIDE HOT MIX ASPHALT MIXTURE TYPES PER SECTION 460 OF THE WISCONSIN STANDARD SPECIFICATIONS FOR HIGHWAY AND STRUCTURE CONSTRUCTION. CONTRACTOR TO PROVIDE AGGREGATE BASE AND HOT MIX ASPHALT PAVEMENT TYPES AND DEPTHS AS INDICATED BELOW (VERIFY W/ GEOTECH REPORT):

STANDARD ASPHALT PAVING 1-1/2" SURFACE COURSE (5 LT 58-28S) 1-1/2" SURFACE COURSE (5 LT 58-28S) 2" BINDER COURSE (3 LT 58-28S) 2-1/2" BINDER COURSE (3 LT 58-28S) 10" OF 1-1/4" CRUSHED AGGREGATE 12" OF 1-1/4" CRUSHED AGGREGATE

CONSTRUCTION STAKING SERVICES

<u>GENERAL PROJECT NOTES</u>

SURVEY CONTROL WILL NOT BE PROVIDED FOR STAKING PURPOSES.

THE CONTRACTOR IS RESPONSIBLE FOR OBTAINING ALL WORK IN ROW PERMITS.

3. THE CONTRACTOR SHALL OBTAIN DOT DRIVEWAY PERMIT PRIOR TO CONSTRUCTION.

B. CONTRACTOR TO COMPACT THE AGGREGATE BASE, ASPHALT BINDER COURSE, AND ASPHALT SURFACE COURSE TO AN AVERAGE DENSITY PER WISCONSIN STANDARD SPECIFICATIONS FOR HIGHWAY AND STRUCTURE CONSTRUCTION. ALL ASPHALT PAVEMENT AREAS SHALL BE PAVED TO WITHIN 0.10' OF DESIGN SURFACE GRADES WITH POSITIVE DRAINAGE BEING MAINTAINED IN ACCORDANCE WITH DESIGN PLANS. A MINIMUM OF 1% SLOPE SHALL BE MAINTAINED IN ALL C. HOT MIX ASPHALT CONSTRUCTION TO BE PROVIDED PER MORE STRINGENT REQUIREMENTS OF GEOTECHNICAL REPORT OR CONSTRUCTION DOCUMENTS. D. CONTRACTOR TO PROVIDE 4" WIDE PAINTED STRIPING (COLOR BY OWNER) FOR PARKING STALLS, TRAFFIC LANES, AND NO PARKING AREAS. PAINT MARKINGS (COLOR BY OWNER) SHALL ALSO BE PROVIDED FOR H.C. ACCESSIBLE SYMBOLS, TRAFFIC ARROWS, AND TRAFFIC MESSAGES.

CONSTRUCTION STAKING SHALL BE COMPLETED BY EXCEL ENGINEERING AS REQUESTED BY THE CONTRACTOR AT CONTRACTOR'S EXPENSE. CONTRACTOR TO CONTACT RYAN WILGREEN AT 920-926-9800 TO GET STAKIN PRICE TO INCLUDE IN BID TO OWNER. PAYMENT OF STAKING COSTS ABOVE AND BEYOND THE BASE PRICE DUE

TO RESTAKING WILL BE THE RESPONSIBILITY OF THE CONTRACTOR, NOT THE OWNER. CAD DRAWING FILES AND

ALL DRIVEWAYS TO BE CONSTRUCTED ACCORDING TO LOCAL ORDINANCES. CONTRACTOR TO OBTAIN ALL

CONTRACTOR TO CONTACT EXCEL ENGINEERING TO COMPLETE AS-BUILT SURVEY OF STORMWATER TREATMENT

FACILITIES FOLLOWING COMPLETION OF THE CONSTRUCTION PER DANE COUNTY REQUIREMENTS.

#### 32 20 00 CONCRETE AND AGGREGATE BASE

- A. CONTRACTOR TO PROVIDE CRUSHED AGGREGATE BASE AND CONCRETE WHERE INDICATED ON THE PLANS. B. ALL AGGREGATE PROVIDED MUST COMPLY WITH SECTION 305 OF THE WISCONSIN STANDARD SPECIFICATIONS FOR HIGHWAY AND STRUCTURE CONSTRUCTION. ALL AGGREGATE PLACED MUST BE COMPACTED TO AN AVERAGE DENSITY PER WISCONSIN STANDARD SPECIFICATIONS FOR HIGHWAY AND STRUCTURE
- C. DESIGN AND CONSTRUCTION OF ALL CAST-IN-PLACE EXTERIOR CONCRETE FLAT WORK SHALL CONFORM TO ACI 330R-08 D. EXTERIOR CONCRETE FLAT WORK CONSTRUCTION TO BE PROVIDED PER MORE STRINGENT REQUIREMENTS OF THE GEOTECHNICAL REPORT OR THIS SPECIFICATION. CONCRETE FLAT WORK CONSTRUCTION IS AS FOLLOWS (VERIFY W/ GEOTECH REPORT): . SIDEWALK CONCRETE - 4" OF CONCRETE OVER 4" OF 3/4" CRUSHED AGGREGATE BASE. CONTRACTION JOINTS SHALL CONSIST OF 1/8" WIDE BY 1" DEEP TOOLED JOINT WHERE INDICATED ON THE PLANS.

WITH 6"X6" #6 GAUGE W.W.M. CONTRACTION JOINTS SHALL BE SAWCUT 1.5" IN DEPTH AND BE SPACED A MAXIMUM OF 15' ON CENTER.

2. LOADING DOCK CONCRETE - 8" OF CONCRETE OVER 6" OF 3/4" CRUSHED AGGREGATE BASE a. CONCRETE SHALL BE REINFORCED WITH 6"X6" #6 GAUGE W.W.M. b. LOADING DOCK CONCRETE JOINTING SHALL BE AS FOLLOWS:

1) CONTRACTION SAWCUT JOINT -CONTRACTOR SHALL PROVIDE A SAWCUT JOINT AT MAXIMUM SPACING OF 15' ON CENTER. SAWCUT JOINT SHALL BE 2" IN 2) TYPICAL POUR CONTROL JOINT - POUR CONTROL JOINT SHALL BE PROVIDED WITH 1-1/4" DIAMETER BY 20" LONG SMOOTH DOWEL PLACED AT 12" ON CENTER. ONE HALF OF THE DOWEL SHALL BE GREASED. GREENSTREAK 9" SPEED DOWEL TUBES SHALL BE USED. 3. HEAVY DUTY CONCRETE (TRUCK TRAFFIC) - 6" OF CONCRETE OVER 6" OF 3/4" CRUSHED AGGREGATE. CONCRETE SHALL BE RFINFORCED

E. DESIGN MIXES SHALL BE IN ACCORDANCE WITH ASTM C94 1. STRENGTH TO BE MINIMUM OF 4,000 PSI AT 28 DAYS FOR EXTERIOR CONCRETE

2. SLUMP SHALL NOT EXCEED 4" FOR EXTERIOR CONCRETE FLAT WORK 3. SLUMP SHALL BE 2.5" OR LESS FOR SLIP-FORMED CURB AND GUTTER

4. SLUMP SHALL BE BETWEEN 1.5" TO 3" FOR NON SLIP-FORMED CURB AND GUTTER 5. ALL EXTERIOR CONCRETE SHALL BE AIR ENTRAINED WITH 4% TO 7% AIR CONTENT. NO OTHER ADMIXTURES SHALL BE USED WITHOUT APPROVAL OF EXCEL ENGINEERING, INC. CALCIUM CHLORIDE SHALL NOT BE USED. 6. MAXIMUM AGGREGATE SIZE FOR ALL EXTERIOR CONCRETE SHALL BE 0.75 INCHES.

F. VERIFY EQUIPMENT CONCRETE PAD SIZES WITH RESPECTIVE CONTRACTORS. PADS SHALL HAVE FIBERMESH 300 FIBERS AT A RATE OF 1.5 LBS/CU. YD. OR 6 X 6-W1.4 X W1.4 WELDED WIRE MESH WITH MINIMUM 1 INCH COVER. EQUIPMENT PADS SHALL BE 3.5 INCHES THICK WITH 1 INCH CHAMFER UNLESS SPECIFIED. OTHERWISE. COORDINATE ADDITIONAL PAD REQUIREMENTS WITH RESPECTIVE CONTRACTOR. G. ALL CONCRETE FLAT WORK SURFACES AND CONCRETE CURB FLOWLINES SHALL BE CONSTRUCTED TO WITHIN 0.05' OF DESIGN SURFACE AND FLOWLINE GRADES ASSUMING POSITIVE DRAINAGE IS MAINTAINED IN ACCORDANCE WITH THE DESIGN PLANS.

H. CONCRETE FLAT WORK SHALL HAVE CONSTRUCTION JOINTS OR SAW CUT JOINTS PLACED AS INDICATED ON THE PLANS OR PER THIS SPECIFICATION. SAWCUTS SHALL BE DONE AS SOON AS POSSIBLE, BUT NO LATER THAN 24 HOURS AFTER CONCRETE IS PLACED. CONCRETE CURB AND GUTTER JOINTING SHALL BE PLACED EVERY 10' OR CLOSER (6' MIN.). ALL EXTERIOR CONCRETE SHALL HAVE A LIGHT BROOM FINISH UNLESS NOTED OTHERWISE. A UNIFORM COAT OF A HIGH SOLIDS CURING COMPOUND MEETING ASTM C309 SHOULD BE APPLIED TO ALL EXPOSED CONCRETE SURFACES. ALL CONCRETE IS TO BE CURED FOR 7 DAYS. EXTERIOR CONCRETE SHALL BE SEPARATED FROM BUILDINGS WITH CONTINUOUS 0.5 INCH FIBER EXPANSION JOINT AND/OR 0.25 INCH FIBER EXPANSION JOINT AT DECORATIVE MASONRY UNITS. ALL REINFORCING BARS SHALL BE ASTM A615 GRADE 60. THICKNESS OF CONCRETE COVER OVER REINFORCEMENT SHALL BE NOT LESS THAN 3" WHERE

CONCRETE IS DEPOSITED AGAINST THE GROUND WITHOUT THE USE OF FORMS AND NOT LESS THAN 1.5" IN ALL OTHER LOCATIONS. ALL REINFORCING SHALL BE LAPPED 36 DIAMETERS FOR UP TO #6 BARS. 60 DIAMETERS FOR #7 TO #10 BARS OR AS NOTED ON THE DRAWINGS AND EXTENDED AROUND CORNERS WITH CORNER BARS. PLACING AND DETAILING OF STEEL REINFORCING AND REINFORCING SUPPORTS SHALL BE IN ACCORDANCE WITH CRSI AND ACI MANUAL AND STANDARD PRACTICES. THE REINFORCEMENT SHALL NOT BE PAINTED AND MUST BE FREE OF GREASE/OIL, DIRT OR DEEP RUST WHEN PLACED IN THE WORK. ALL WELDED WIRE FABRIC SHALL MEET THE REQUIREMENTS OF ASTM A 185. WELDED WIRE FABRIC SHALL BE PLACED 2" FROM TOP OF SLAB, UNLESS INDICATED CONTRACTOR SHALL ENGAGE A QUALIFIED INDEPENDENT TESTING AND INSPECTING AGENCY TO SAMPLE MATERIALS, PERFORM TESTS, AND SUBMIT TEST REPORTS DURING CONCRETE PLACEMENT. TESTS WILL BE PERFORMED ACCORDING TO ACI 301. CAST AND LABORATORY CURE ONE SET OF FOUR STANDARD

CYLINDERS FOR EACH COMPOSITE SAMPLE FOR EACH DAY'S POUR OF EACH CONCRETE MIX EXCEEDING 5 CU. YD., BUT LESS THAN 25 CU. YD., PLUS ONE SET FOR EACH ADDITIONAL 50 CU. YD. OR FRACTION THEREOF, PERFORM COMPRESSIVE-STRENGTH TESTS ACCORDING TO ASTM C 39, TEST TWO SPECIMENS AT 7 DAYS AND TWO SPECIMENS AT 28 DAYS. PERFORM SILUMP TESTING ACCORDING TO ASTM C 143. PROVIDE ONE TEST AT POINT OF PLACEMENT FOR EACH COMPOSITE SAMPLE, BUT NOT LESS THAN ONE TEST FOR EACH DAY'S POUR OF EACH CONCRETE MIX. PERFORM ADDITIONAL TESTS WHEN CONCRETE CONSISTENCY APPEARS TO CHANGE. K. PROTECT FRESHLY PLACED CONCRETE FROM PREMATURE DRYING AND EXCESSIVE COLD OR HOT TEMPERATURES. IN HOT, DRY, AND WINDY WEATHER, APPLY AN EVAPORATION-CONTROL COMPOUND ACCORDING TO MANUFACTURER'S INSTRUCTIONS AFTER SCREEDING AND BULL FLOATING, BUT BEFORE POWER .. LIMIT MAXIMUM WATER-CEMENTIOUS RATIO OF CONCRETE EXPOSED TO FREEZING, THAWING AND DEICING SALTS TO 0.45.

M. TEST RESULTS WILL BE REPORTED IN WRITING TO THE DESIGN ENGINEER, READY-MIX PRODUCER, AND CONTRACTOR WITHIN 24 HOURS AFTER TESTS. REPORTS OF COMPRESSIVE STRENGTH TESTS SHALL CONTAIN THE PROJECT IDENTIFICATION NAME AND NUMBER, DATE OF CONCRETE PLACEMENT, NAME OF CONCRETE TESTING SERVICE, CONCRETE TYPE AND CLASS, LOCATION OF CONCRETE BATCH IN STRUCTURE, DESIGN COMPRESSIVE STRENGTH AT 28 DAYS, CONCRETE MIX PROPORTIONS AND MATERIALS, COMPRESSIVE BREAKING STRENGTH, AND TYPE OF BREAK FOR BOTH 7-DAY TESTS AND 28-DAY TESTS.

#### 32 30 00 LANDSCAPING AND SITE STABILIZATION

A TOPSOIL: CONTRACTOR TO PROVIDE A MINIMUM OF 6" OF TOPSOIL FOR ALL DISTURBED OPEN AREAS. RELISE SURFACE SOIL STOCKPILED ON SITE AND SUPPLEMENT WITH IMPORTED OR MANUFACTURED TOPSOIL FROM OFF SITE SOURCES WHEN QUANTITIES ARE INSUFFICIENT. PROVIDE SOIL ANALYSIS BY A QUALIFIED SOIL TESTING LABORATORY AS REQUIRED TO VERIFY THE SUITABILITY OF SOIL TO BE USED AS TOPSOIL AND TO DETERMINE THE NECESSARY SOIL AMENDMENTS. TEST SOIL FOR PRESENCE OF ATRAZINE AND INFORM EXCEL ENGINEERING, INC. IF PRESENT PRIOR TO BIDDING PROJECT. TOPSOIL SHALL HAVE A PH RANGE OF 5.5 TO 8, CONTAIN A MINIMUM OF 5 PERCENT ORGANIC MATERIAL CONTENT, AND SHALL BE FREE OF STONES 1 INCH OR LARGER IN DIAMETER. ALL MATERIALS HARMFUL TO PLANT GROWTH SHALL ALSO BE REMOVED TOPSOIL INSTALLATION: LOOSEN SUBGRADE TO A MINIMUM DEPTH OF 6 INCHES AND REMOVE STONES LARGER THAN 1" IN DIAMETER. ALSO REMOVE ANY STICKS. ROOTS. RUBBISH. AND OTHER EXTRANEOUS MATTER AND DISPOSE OF THEM OFF THE PROPERTY. SPREAD TOPSOIL TO A DEPTH OF 6" BUT NOT LESS THAN WHAT IS REQUIRED TO MEET FINISHED GRADES AFTER LIGHT ROLLING AND NATURAL SETTLEMENT. DO NOT SPREAD TOPSOIL IF SUBGRADE IS FROZEN. MUDDY, OR EXCESSIVELY WET. GRADE PLANTING AREAS TO A SMOOTH, UNIFORM SURFACE PLANE WITH LOOSE, UNIFORMLY FINE TEXTURE. GRADE TO WITHIN 0.05 FEET OF FINISHED GRADE ELEVATION.

PERMANENT LAWN AREAS SHALL BE SEEDED WITH THE FOLLOWING MIXTURE: 65% KENTUCKY BLUEGRASS BLEND (2.0-2.6 LBS./1,000 S.F.), 20% PERENNIAL RYEGRASS (0.6-0.8 LBS./1,000 S.F.), 15% FINE FESCUE (0.4-0.6 LBS/1,000 S.F.). STRAW AND MULCH SHALL BE LAID AT 100LBS/1,000 S.F. FERTILIZE AS PER SOIL TEST OR APPLY 5-10-10 OR EQUIVALENT AT 5-6 LBS/1,000 S.F. SEE EROSION MATTING SPECIFICATIONS AS REQUIRED. ALL SITE DISTURBED AREAS NOT DESIGNATED FOR OTHER LANDSCAPING AND SITE STABILIZATION METHODS SHALL BE SEEDED AS PERMANENT LAWN. NO BARE TOPSOIL SHALL BE LEFT

IRREGULARITIES. LAWN COVERAGE SHOULD EXCEED 90% AND BARE SPOTS SHOULD NOT EXCEED 5"X5". CONTRACTOR SHOULD REESTABLISH LAWNS THAT DO

2. ALL PERMANENT AND TEMPORARY STORM WATER CONVEYANCE SWALE BOTTOMS AND SIDE SLOPES SHALL BE SEEDED WITH THE FOLLOWING MIXTURE: 45% KENTUCKY BLUEGRASS (0.60 LBS /1000 S.E.). 40% CREEPING RED FESCUE (0.50 LBS /1.000 S.E.). AND 15% PERENNIAL RYEGRASS (0.20 LBS /1.000 S.E.). FERTILIZE AS PER SOIL TEST OR APPLY 5-10-10 OR EQUIVALENT AT 5-6 LBS /1 000 S.E. SEE FROSION MATTING SPECIFICATIONS AS REQUIRED. 3. ALL TEMPORARY SEEDING SHALL CONSIST OF THE FOLLOWING MIXTURE: 100% RYEGRASS AT 1.9 LBS./1.000 S.F. STRAW AND MULCH SHALL BE LAID AT 100 LBS./1,000 S.F. FERTILIZE AS PER SOIL TEST OR APPLY 5-10-10 OR EQUIVALENT AT 5-6 LBS./1,000 S.F. SEE EROSION MATTING SPECIFICATIONS AS REQUIRED. . SEEDED LAWN MAINTENANCE: CONTRACTOR TO PROVIDE MAINTENANCE OF ALL LANDSCAPING FOR A PERIOD OF 90 DAYS FROM THE DATE OF INSTALLATION. AT THE END OF THE MAINTENANCE PERIOD, A HEALTHY, UNIFORM, CLOSE STAND OF GRASS SHOULD BE ESTABLISHED FREE OF WEEDS AND SURFACE

NOT COMPLY WITH THESE REQUIREMENTS AND CONTINUE MAINTENANCE UNTIL LAWNS ARE SATISFACTORY. CONTRACTOR TO PROVIDE EROSION CONTROL MATTING (NORTH AMERICAN GREEN \$150) OR EQUIVALENT ON ALL SLOPES THAT ARE 4:1 AND GREATER

OUTSIDE OF STORMWATER CONVEYANCE SWALES. 2. CONTRACTOR TO PROVIDE EROSION MATTING (NORTH AMERICAN GREEN C125) OR EQUIVALENT IN ALL SWALE BOTTOMS AS REQUIRED. E. RIP RAP: ALL RIP RAP ASSOCIATED WITH STORMWATER MANAGEMENT AND STORMWATER CONVEYANCE, AS DELINEATED ON THE PLANS, SHALL BE CONSTRUCTED WITH THE TOP OF RIP RAP MATCHING THE PROPOSED ADJACENT GRADE ELEVATIONS. PLACEMENT OF RIP RAP ABOVE THE PROPOSED

ADJACENT GRADE ELEVATIONS IS NOT ACCEPTABLE. ALL RIP RAP SHALL BE PLACED ON TYPE HR FILTER FABRIC PER SECTION 645 OF THE WISCONSIN STANDARD SPECIFICATIONS FOR HIGHWAY AND STRUCTURAL CONSTRUCTION. F. TREES AND SHRUBS: FURNISH NURSERY-GROWN TREES AND SHRUBS WITH HEALTHY ROOT SYSTEMS DEVELOPED BY TRANSPLANTING OR ROOT PRUNING. OVIDE WELL-SHAPED, FULLY BRANCHED, AND HEALTHY LOOKING STOCK. STOCK SHOULD ALSO BE FREE OF DISEASE, INSECTS, EGGS, LARVAE, AND DEFECTS SUCH AS KNOTS, SUN SCALD, INJURIES, ABRASIONS, AND DISFIGUREMENT. SEE THE LANDSCAPE PLAN FOR SPECIFIC SPECIE TYPE, SIZE, AND LOCATION. . TREE AND SHRUB INSTALLATION: EXCAVATE CIRCULAR PITS WITH SIDES SLOPED INWARD. TRIM BASE LEAVING CENTER AREA RAISED SLIGHTLY TO SUPPORT ROOT BALL. EXCAVATE PIT APPROXIMATELY THREE TIMES AS WIDE AS THE ROOT BALL DIAMETER. SET TREES AND SHRUBS PLUMB AND IN CENTER OF PIT WITH TOP OF BALL 1" ABOVE ADJACENT FINISHED GRADES. PLACE PLANTING SOIL MIX AROUND ROOT BALL IN LAYERS AND TAMP TO SETTLE MIX. WATER ALL PLANTS THOROUGHLY. PROVIDE TEMPORARY STAKING FOR TREES AS REQUIRED. H. TREE AND SHRUB MAINTENANCE/WARRANTY: CONTRACTOR TO PROVIDE MAINTENANCE OF ALL LANDSCAPING FOR A PERIOD OF 90 DAYS FROM THE DATE OF INSTALLATION. MAINTENANCE TO INCLUDE REGULAR WATERING AS REQUIRED FOR SUCCESSFUL PLANT ESTABLISHMENT. CONTRACTOR TO PROVIDE 1 YEAR WARRANTY ON ALL TREES, SHRUBS, AND PERENNIALS.

MINERAL MULCH: PROVIDE 3" MINIMUM THICK BLANKET OF 0.75" MINIMUM TO 1.5" MAXIMUM CRUSHED DECORATIVE STONE AT ALL PLANTING AREAS INDICATED N THE LANDSCAPE PLAN. INSTALL OVER NON-WOVEN WEED BARRIER FABRIC. COLOR BY OWNER. J. PLASTIC EDGING: INSTALL VALLEY VIEW INDUSTRIES BLACK DIAMOND LAWN EDGING TO SEPARATE ALL PLANTING BEDS FROM LAWN AREAS. EDGING TO BE 5.5" TALL WITH METAL STAKES INSTALLED PER MANUFACTURER'S WRITTEN INSTRUCTIONS.

## DIVISION 33 UTILITIES

## 33 10 00 SITE UTILITIES

J. SEE PLANS FOR ALL OTHER UTILITY SPECIFICATIONS AND DETAILS.

A. CONTRACTOR TO FIELD VERIFY ALL EXISTING UNDERGROUND UTILITIES ON SITE. CONTRACTOR TO VERIFY PIPE LOCATIONS, SIZES, AND DEPTHS AT POINT OF PROPOSED CONNECTIONS AND VERIFY PROPOSED UTILITY ROUTES ARE CLEAR (PER CODE) OF ALL EXISTING UTILITIES AND OTHER OBSTRUCTIONS PRIOR TO CONSTRUCTION. COSTS INCURRED FOR FAILURE TO DO SO SHALL BE THE CONTRACTORS RESPONSIBILITY.

B. ALL PROPOSED SANITARY PIPE SHALL BE SDR-35 PVC C. CLEANOUTS SHALL BE PROVIDED FOR THE SANITARY SERVICE AT LOCATIONS INDICATED ON THE UTILITY PLAN. THE CLEANOUT SHALL CONSIST OF A COMBINATION WYE FITTING IN LINE WITH THE SANITARY SERVICE WITH THE CLEANOUT LEG OF THE COMBINATION WYE FACING STRAIGHT UP. THE CLEANOUT SHALL CONSIST OF A 6" VERTICAL PVC PIPE WITH A WATER TIGHT REMOVABLE CLEANOUT PLUG. AN 8" PVC FROST SLEEVE SHALL BE PROVIDED. THE BOTTOM OF THE FROST SLEEVE SHALL TERMINATE 12" ABOVE THE TOP OF THE SANITARY LATERAL OR AT LEAST 6" BELOW THE PREDICTED FROST DEPTH, WHICHEVER IS SHALLOWER. THE CLEANOUT SHALL EXTEND JUST ABOVE THE SURFACE GRADE IN LAWN OR LANDSCAPE AREAS WITH THE FROST SLEEVE TERMINATING AT THE GRADE SURFACE. THE CLEANOUT SHALL EXTEND TO 4 INCHES BELOW SURFACE GRADE IN PAVED SURFACES WITH A ZURN (Z-1474-N) HEAVY DUTY CLEANOUT HOUSING PLACED OVER THE TOP OF THE CLEANOUT FLUSH WITH THE SURFACE GRADE. IN PAVED SURFACES, THE FROST SLEEVE SHALL TERMINATE IN A CONCRETE PAD AT LEAST 6" THICK AND EXTENDING AT LEAST 9" FROM THE SLEEVE ON ALL SIDES, SLOPING AWAY FROM THE SLEEVE. THE CLEANOUT HOUSING SHALL BE CONSTRUCTED PER MANUFACTURERS REQUIREMENTS.

D. ALL PROPOSED WATER PIPE SHALL BE C906 PE FOR PIPE DIAMETERS OF 4" OR LESS, C900 PVC FOR PIPE DIAMETERS OF 6" THROUGH 12", AND C-905 PVC FOR PIPE DIAMETERS OF 14" THROUGH 36". 6' MINIMUM COVER SHALL BE PROVIDED OVER ALL WATER PIPING UNLESS OTHERWISE SPECIFIED. E. ALL PROPOSED HDPE STORM PIPE SHALL BE IN ACCORDANCE WITH ASTM F2648. ALL CONCRETE STORM PIPING SHALL BE IN ACCORDANCE WITH ASTM C14 AND ASTM C76. SEE UTILITY PLANS FOR ALL STORM PIPE MATERIAL TYPES TO BE USED. PIPE SHALL BE PLACED MIN. 8' HORIZONTALLY FROM FOUNDATION WALLS. F. SANITARY, STORM, AND WATER UTILITY PIPE INVERTS SHALL BE CONSTRUCTED WITHIN 0.10' OF DESIGN INVERT ELEVATIONS ASSUMING PIPE SLOPE AND

SEPARATION IS MAINTAINED PER THE UTILITY DESIGN PLANS AND STATE REQUIREMENTS. G. SITE UTILITY CONTRACTOR SHALL RUN SANITARY SERVICE TO A POINT WHICH IS A MINIMUM OF 5' FROM THE EXTERIOR WALL OF THE FOUNDATION. SITE UTILITY CONTRACTOR SHALL RUN WATER SERVICE TO A POINT WITHIN THE FOUNDATION SPECIFIED BY THE PLUMBING PLANS. CONTRACTOR TO CUT AND CAP WATER SERVICE 12" ABOVE FINISHED FLOOR ELEVATION. H. ALL UTILITIES SHALL BE INSTALLED WITH PLASTIC COATED TRACER WIRE (10 TO 14 GAUGE SOLID COPPER, OR COPPER COATED STEEL WIRE). PLASTIC WIRE MAY BE TAPED TO PLASTIC WATER OR SEWER PIPE. IF ATTACHED, THE TRACER WIRE SHALL BE SECURED EVERY 6 TO 20 FEET AND AT ALL BENDS. TRACER WIRE SHALL HAVE ACCESS POINTS AT LEAST EVERY 300 FEET. ALL LITH ITIES SHALL BE INSTALLED PER STATE LOCAL AND INDUSTRY STANDARDS. WATER SANITARY AND STORM SEWER SHALL BE INSTALLED PER "STANDARD SPECIFICATION FOR SEWER AND WATER CONSTRUCTION IN WISCONSIN" OR OTHER APPLICABLE CODES. THE DESIGN ENGINEER SHALL BE RESPONSIBLE FOR OBTAINING STATE PLUMBING REVIEW APPROVAL. CONTRACTOR TO OBTAIN STATE PLUMBING APPROVAL FOR SEPTIC & WELL

CONSTRUCTION. THE CONTRACTOR IS RESPONSIBLE FOR OBTAINING ALL OTHER PERMITS REQUIRED TO INSTALL WATER, SANITARY AND STORM SEWER.

N216 State Road 55 P.O. Box 620 Kaukauna, WI 54130 PHONE (920) 766-5795 1-800-236-2534 FAX (920) 766-5004

MILWAUKEE W204 N11509 Goldendale Rd Germantown, WI 53022 PHONE (715) 849-3141 PHONE (262) 250-9710 1-800-236-2534

"COPYRIGHT NOTICE" This design, drawing and detail is the copyrighted property of KELLER, INC. distributed, disclosed or made available to anyone without the expressed written consent of KELLER, INC.

PRELIMINARY PLAN DATE

PROJECT MANAGER: DESIGNER: R. LINDSTROM DRAWN BY: EXCEL ENGINEERING, INC. **EXPEDITOR:** SUPERVISOR: \_\_\_\_\_ PRELIMINARY NO: CONTRACT NO: \_\_\_\_\_

JULY 20, 2017

CIVIL COVER AND SPECIFICATION SHEET

PRELIMINARY DRAWING - NOT FOR CONSTRUCTION